


Sample Layouts - Larger Fixtures


Conference Room - 20' x 12' x 10'
two indirect fixtures
with three BX55W lamps

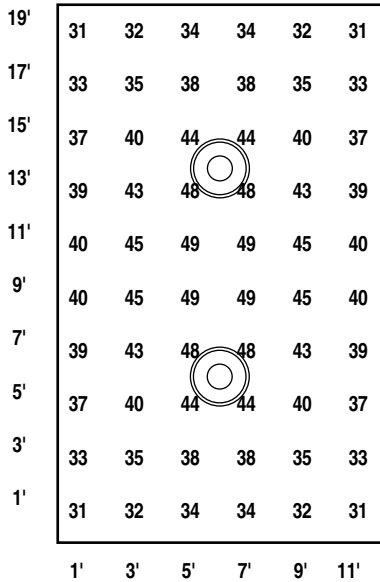

P-I-3330BX55-ELB
EFFICIENCY: 84%
ROOM: 20' X 12' X 10'
SUSPENSION: 24"
SPACING: 8' OC
REFLECTANCES: 80/50/20
LIGHT LOSS FACTOR: .75
POWER DENSITY: 1.5 W/ft²
AVERAGE MAINTAINED fc: 44

Maintained fc at 30" workplane


Conference Room - 20' x 12' x 10'
two indirect/direct fixtures
with three BX50W lamps for up-light
and one 21W 2D lamp for down-light

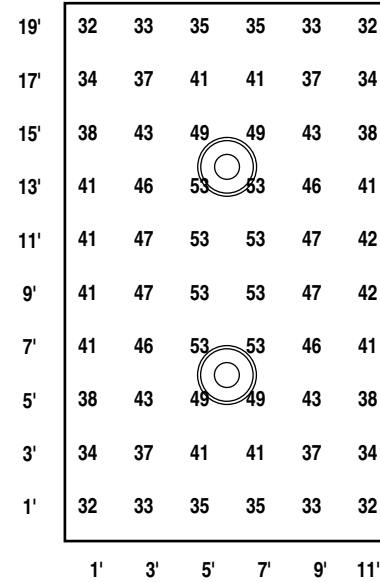

P-ID-3330BX50/21-FP-ELB
EFFICIENCY: 83%
ROOM: 20' X 12' X 10'
SUSPENSION: 24"
SPACING: 8' OC
REFLECTANCES: 80/50/20
LIGHT LOSS FACTOR: .75
POWER DENSITY: 1.5 W/ft²
AVERAGE MAINTAINED fc: 44

Maintained fc at 30" workplane


Classroom - 24' x 32' x 10'
four indirect fixtures
with six BX50W lamps

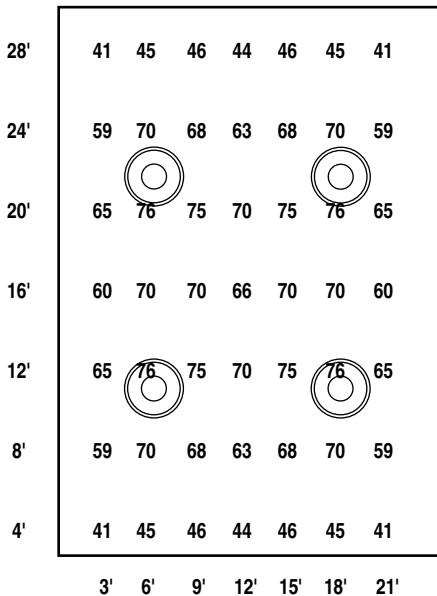

P-I-3360BX50-ELB
EFFICIENCY: 80%
ROOM: 24' X 32' X 10'
SUSPENSION: 24"
SPACING: 12' OC
REFLECTANCES: 80/50/20
LIGHT LOSS FACTOR: .75
POWER DENSITY: 1.27 W/ft²
AVERAGE MAINTAINED fc: 58

Maintained fc at 30" workplane

Small Office - 12' x 15' x 12'
one indirect/direct fixture
with six BX50W lamps for up-light
and one 21W 2D lamp for down-light

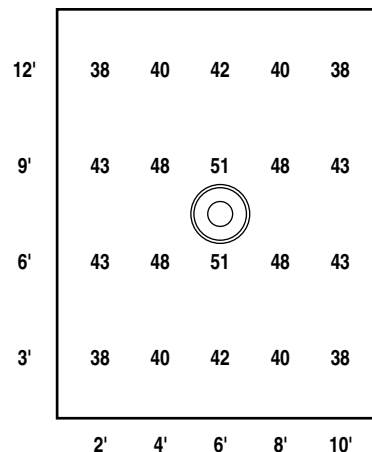


P-ID-3360BX50/21-FP-ELB
EFFICIENCY: 79%
ROOM: 12' X 15' X 12'
SUSPENSION: 24"
REFLECTANCES: 80/50/20
LIGHT LOSS FACTOR: .75
POWER DENSITY: 1.4 W/ft²
AVERAGE MAINTAINED fc: 44

Maintained fc at 30" workplane



Sample Layouts - Larger Fixtures


Open Office - 60' x 60' x 12'
 twenty five indirect fixtures
 with six BX40W lamps

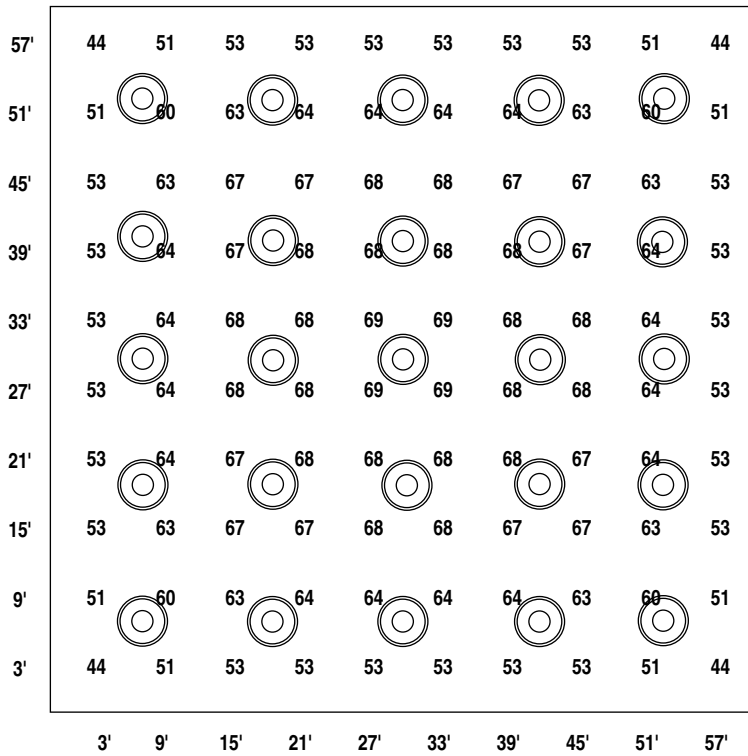

P-I-3360BX40-ELB
 EFFICIENCY: 80%
 ROOM: 60' X 60' X 12'
 SUSPENSION: 30"
 SPACING: 12' OC
 REFLECTANCES: 80/50/20
 LIGHT LOSS FACTOR: .75
 POWER DENSITY: 1.4 W/ft²
 AVERAGE MAINTAINED fc: 66
 CEILING UNIFORMITY: 9.5:1

Maintained fc at 30" workplane

Lobby - 25' x 35' x 12'
 five indirect fixtures
 with six BX40W lamps

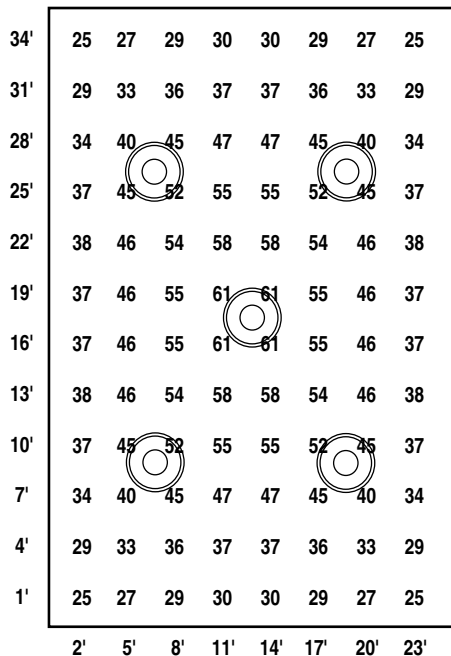

P-I-3360BX40-ELB
 EFFICIENCY: 80%
 ROOM: 25' X 35' X 12'
 SUSPENSION: 30"
 SPACING: OUTER FIXTURES
 11' OC X 16' OC
 REFLECTANCES: 80/50/20
 LIGHT LOSS FACTOR: .75
 POWER DENSITY: 1.16 W/ft²
 AVERAGE MAINTAINED fc: 43

Maintained fc at 30" workplane